

User manual

K-BUS®KNX Gateway for IR configuration_V1.1

Contents

Chapter 1 Summary	1
1.1 KNX Gateway for IR configuration	1
1.2 DCA download and installation overview	2
1.3 The IR Learner (BTIL-01/00.2)	3
Chapter 2 Software Introduction	4
2.1 Software Interface	4
2.2 IR code configuration Interface	8
2.3 IR Code Convert Tool	9
Chapter 3 Demonstration	10
3.1 Communication settings	10
3.2 IR configuration function	11
3.2.1. New Controlled appliance	11
3.2.2. Import\Export IR learning encoding data	14
3.3 Precautions	15

Chapter 1 Summary

We provide KNX Gateway for IR with a configuration tool (KNX Gateway for IR configuration) or DCA, to assist in the learning, testing and configuration of the IR code, as well as downloading the IR code to KNX Gateway for IR which is configured by ETS and enables the KNX bus to control the IR device.

Note: KNX Gateway for IR configuration is a software that runs independently in PC. DCA is an APP plugin of ETS, embedded in the product application.

In addition, the software should be used with IR Learner (BTIL-01/00.2). IR Learner is connected to the PC via USB interface and used to learn the control codes of the keys of the IR Remote Controller, store the codes in the configuration tool. IR Learner can learn more than 95% of the IR Remote Controller on the market. The learning process is realized by operating the software, and you should put the IR detector of the Remote Controller near to IR detector of the IR Learner as close as you can (within 3cm) to avoid the failure of learning. And IR learner also has the functions for IR receiving emitting IR function, so it can test and verify whether the learned control code has been learned correctly.

This manual provides detailed technical information about the KNX Gateway for IR configuration and IR Learner for users as well as assembly and programming details, and explains how to use by the application examples.

1.1 KNX Gateway for IR configuration

KNX Gateway for IR configuration is a software that runs independently in PC. Below describes the overall framework of the software and the use of IR configuration function. The IR configuration function of this software are only available in conjunction with the IR Learner and KNX Gateway for IR.

The functions are summarized as follows:

- Used with IR Learner to assist in the learning, testing and configuration of the IR code, as well as downloading the IR code to KNX Gateway for IR;
- Support to save the IR configuration file and export it.

Operating system: Win7 and above systems;


Operating environment: must install Microsoft.NET Framework 4.6.1 on the PC.

1.2 DCA download and installation overview

DCA's .etsapp file is obtained from the manufacturer or the shop of the MyKNX account (search "KNX Gateway for IR Configuration App"). Then, add APP in the lower right corner of ETS5. If there is an old version before, delete it and restart ETS5 to add a new version of APP. In the project configuration of KNX Gateway for IR, you can see that the editing interface of the database has a DCA menu after the APP is added successfully. Click to see the configuration interface of DCA.

Note: This function only supports to the version with ETS license, that is ETS dongle needs to be installed on the computer, including ETS5Lite, ETS5 Supplementary, ETS5 Professional.

In order to use DCA normally, ETS must run in compatibility mode, which should be activated via ETS Apps in ETS5, as shown as follow figure.

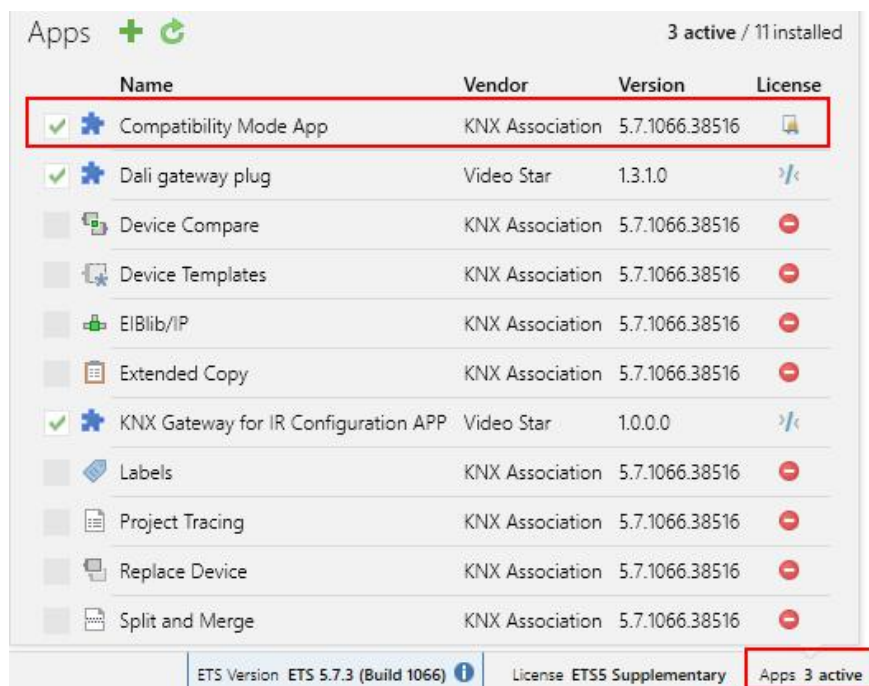

1.3 The IR Learner (BTIL-01/00.2)

The IR Learner uses a common USB port to communicate, it is easy to learn the functional control codes of the IR remote controller and store the codes to the configuration tool.

The design of the IR Learner is as a USB flash Disk, small and exquisite in size. The IR Learner is needed to use only when it learns the functional control codes of the IR remote controller.

Attention: When learning, please put the the IR detector of the Remote Controller near to IR detector of the IR Learner as close as you can(within 3cm) to avoid the failure of learning.

The IR Learner is provided with receiving and emitting IR function, so it can test and verify whether the learned control code has been learned correctly.

For convenient to operate, suggest that connect the IR Learner to PC via a USB extension cord please.



① USB communication port

② IR detector. When learning, please put the IR detector of the Remote Controller near to IR detector of the IR Learner as close as you can

Chapter 2 Software Introduction

2.1 Software Interface

Double-click the software “KNX Gateway for IR configuration.exe” on the desktop or click on the Start Interface to start the software, the initial interface shown as in Fig.2.1.

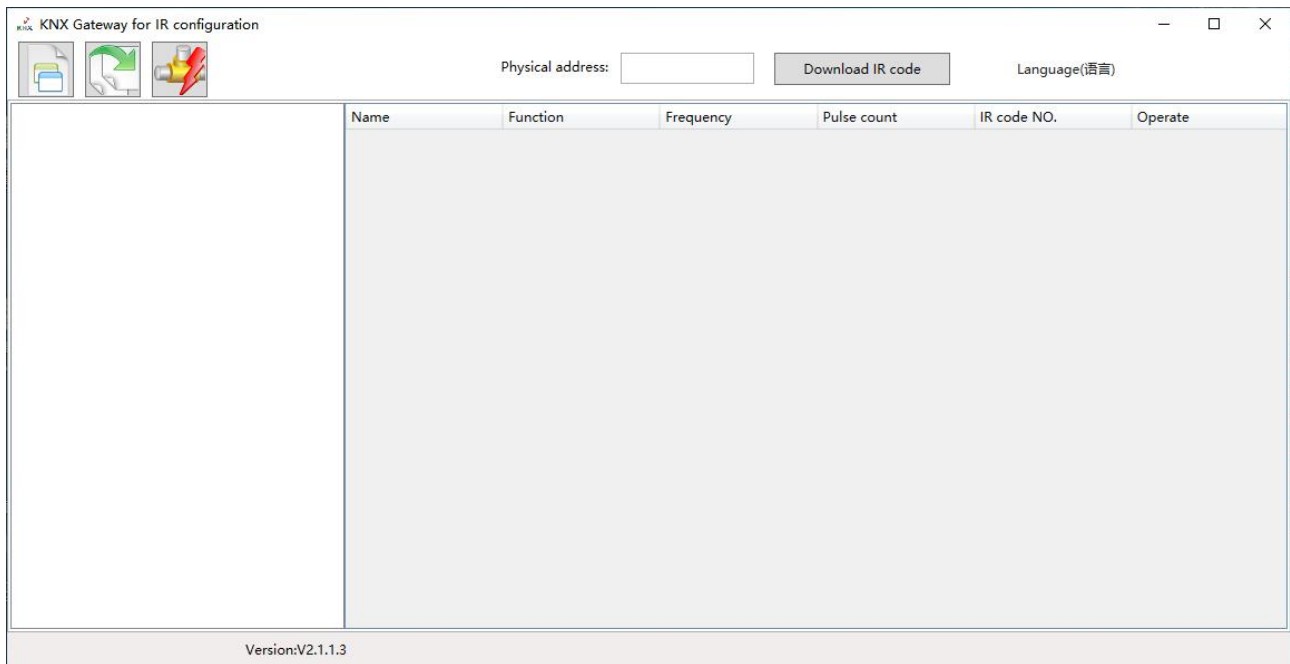


Fig.2.1(1) The initial interface

Note: In Windows 10, you need to right click on the software and select Run as Administrator, and you need to set the screen scale display to 100% as shown below. Otherwise the interface of this program will display abnormally.

Scale and layout

Change the size of text, apps, and other items

100% (Recommended) ▾


[Advanced scaling settings](#)

Resolution

1920 × 1080 (Recommended) ▾

Orientation

Landscape ▾

【New IR configuration file】: Click the icon  to create a new configuration file (Currently only supports the creation of the format.IRPrj), as the following Fig.2.1(2).

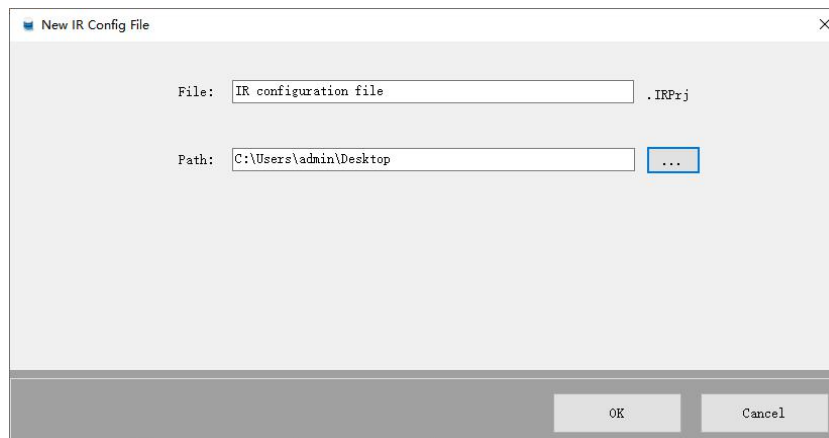




Fig.2.1(2) New IR configuration file

【Open the configuration file】: Click the icon  to open the configuration file (Currently only supports the open of the format.IRPrj).

【Connected to the bus】: Click the icon  to connect or disconnect the communication between the software and the bus. **Note: The DCA does not require a bus connection, bus communication is normally performed via the ETS software.**

【Physical address】: Input the physical address. Support the input of the format xx.xx.xxx, such as 1.1.1.

【Download IR code】: Download the IR code to the KNX Gateway for IR via the KNX bus. Click it to pup up the download window for the download task, and download one task at a time. User can cancel the current task and view the progress via the window.


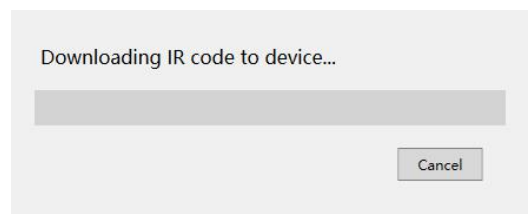



Fig.2.1(3) Down window

Common download failure exceptions:


- ① The device with the entered physical address cannot be connected. For example, the device cannot connect to KNX bus.

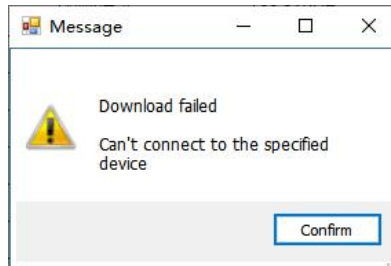


- ② Download is interrupted during an exception. For example, the device is removed, or the bus is abnormal or the others, to make the sending telegram no response or incorrectly.

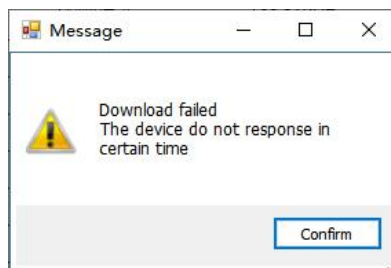


- ③ The device to download is not a KNX gateway for IR.

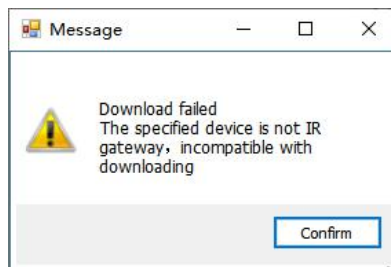


- ④ The physical address format entered is not a xx.xx.xxx.

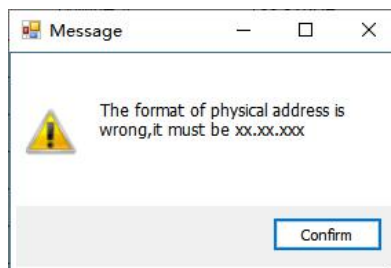

⑤ Exist invalid IR code for the IR code configuration. If an IR number is not within 1~300, an error is reported.

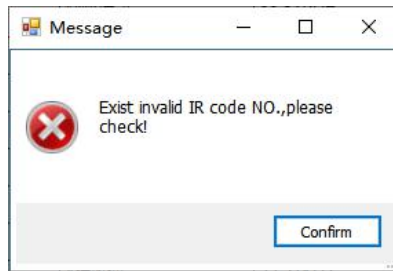

⑥ There is not a interface connecting to software. If not connect the bus firstly to download, an error is reported.

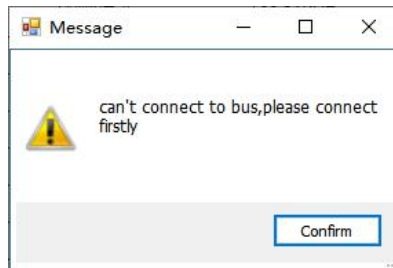

【Language(语言)】: The drop-down menu is shown as Fig.2.1(4), select Chinese or English as the system language.



Fig.2.1(4) 【Language(语言)】 drop-down menu

2.2 IR code configuration Interface

IR configuration interface is used to configure the function of KNX Gateway for IR, through IR Learning Code Manager, we can learn and record each IR encoding of the appliance remote controller's function, download the configuration to the KNX Gateway for IR via the KNX bus, as shown in Fig.2.2.

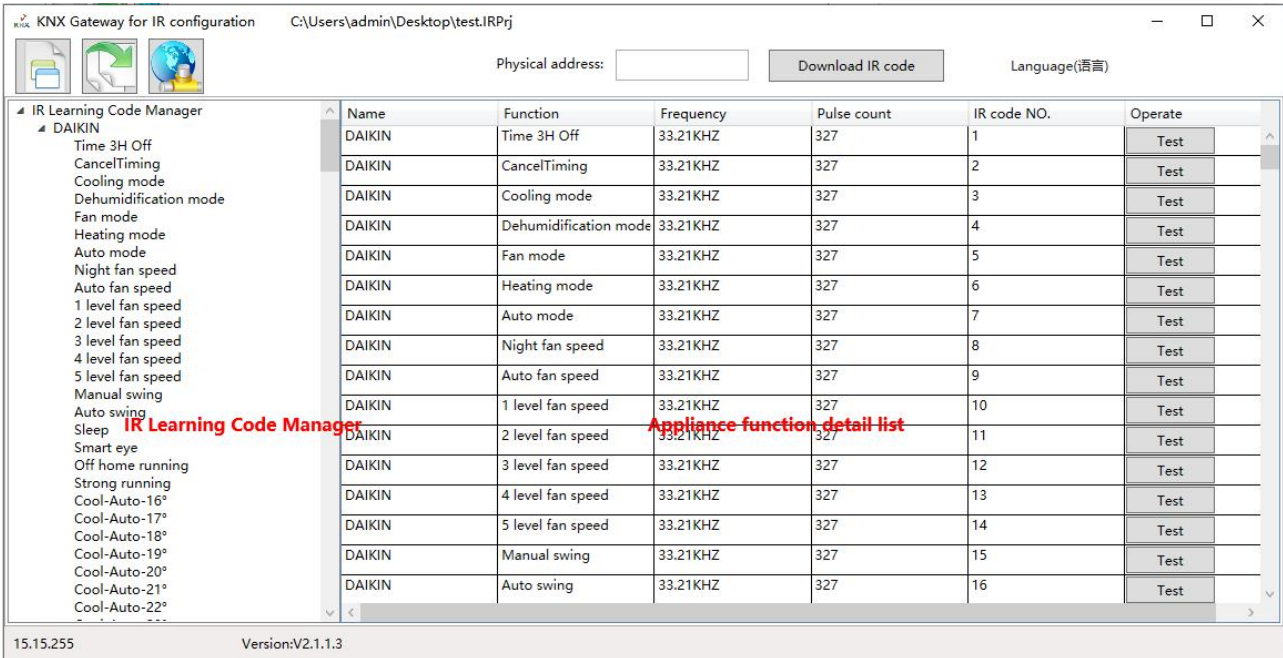


Fig.2.2 IR Configuration


【 IR learning Code manager 】 : Manage the information of the controlled appliances which have IR remote controlled function. It is mainly used for the controlled electrical new, delete, import or export IR learning code, and the remote speed controlled function of appliance’s new and learning, test, and function modification.

【 Appliance function detailed list 】 : The appliance function detailed list is used to display the item sub information which are selected by the learning code manager. we can check the appliance name of selected items, electrical function, the frequency and pulse counting of the electrical function remote controller, also can pass the test to verify the effectiveness of learning code. Double click on the Name, Function and IR code NO. to change the information.

Note: If the IR code number is 0 or empty, user need to manually modify the number.

2.3 IR Code Convert Tool

KNX Gateway for IR configuration and DCA only support the IR code files in the format **IRCode3**. For compatibility with lower versions of IR configuration files, IR code files in the format **IRCode** and **IRCode2** can be converted to **IRCode3** by using the IR Code Convert Tool (V2.0), unzip the zip file below, click on the application **IRConvert Tool**, select an IR code file in old format, click on [确定] and save it, as shown as followed figure.

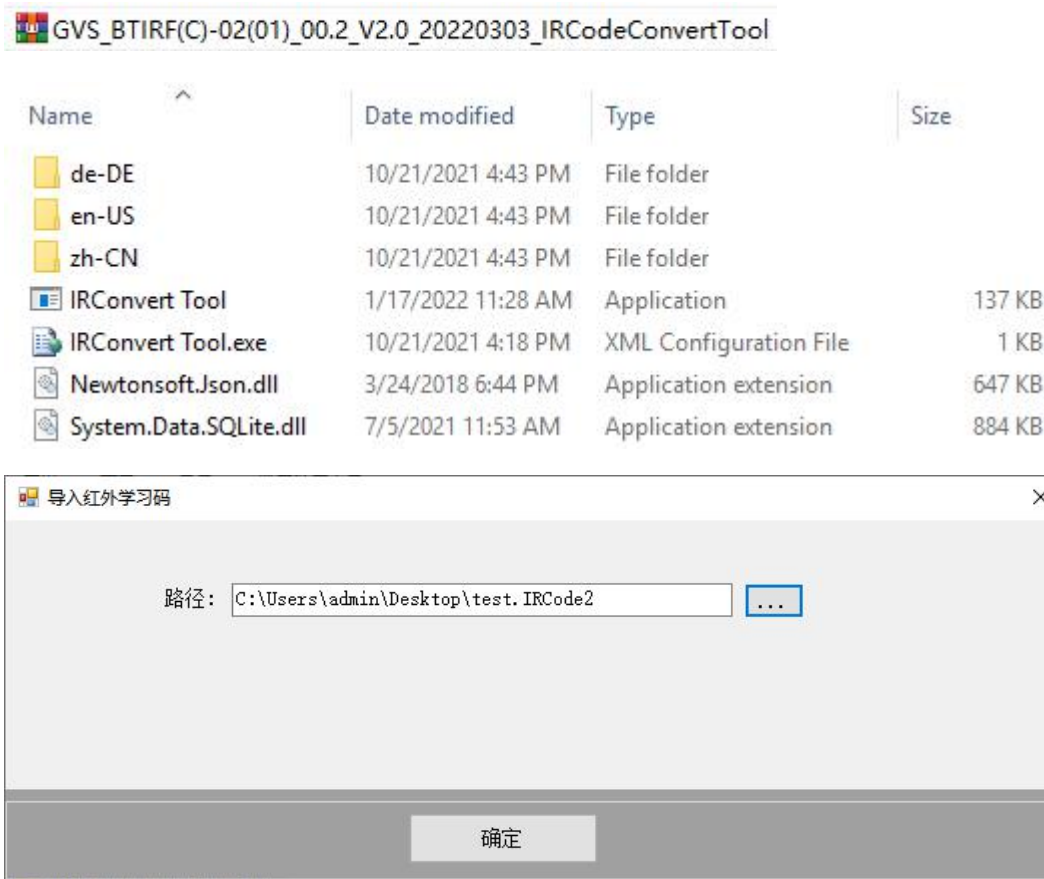


Chapter 3 Demonstration

This chapter describes all the actual operation of the software function and the matters of needing attention.

3.1 Communication settings

Select **【Connected to the bus】** , and then Configure the downloader in the following dialog box, click on **【OK】** .

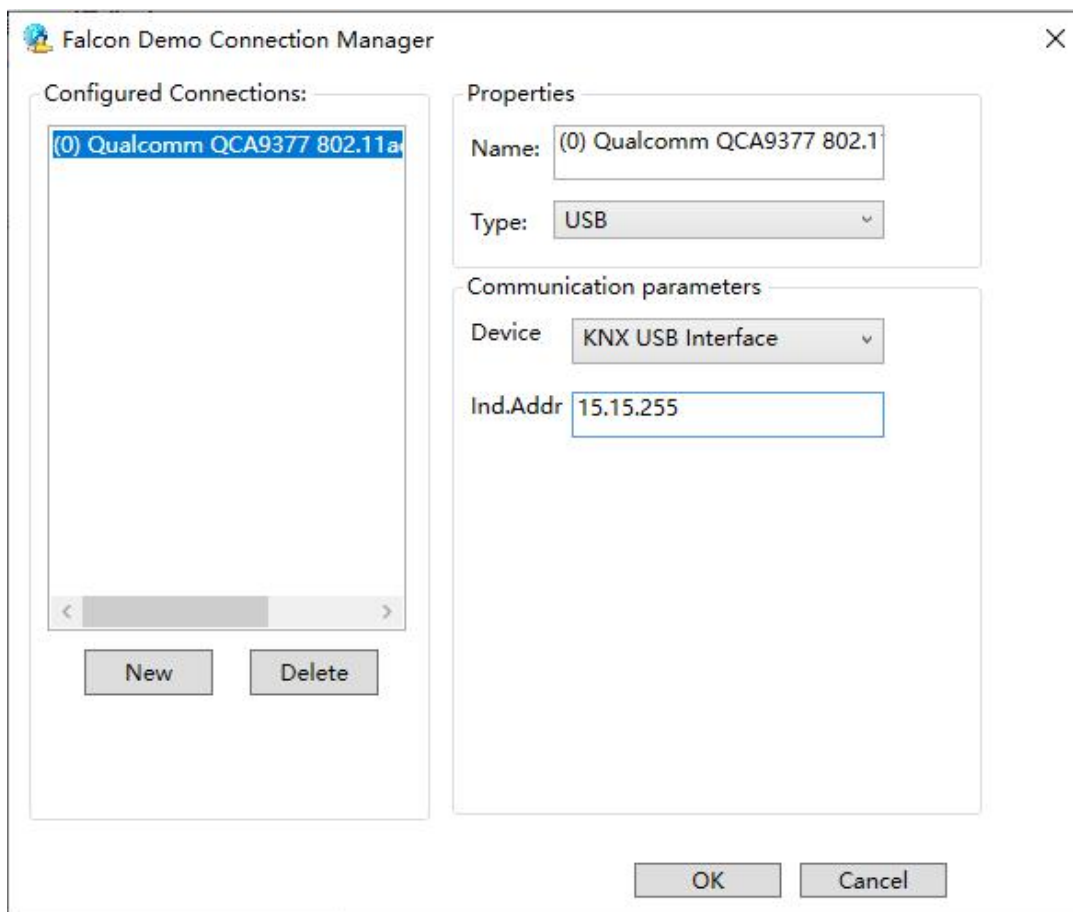


Note: If you select a USB connection in “Configured Connections” box, not detected download device in the right “Communication parameter” box, please check the connection of download device and PC machine .If the connection is well and the downloader is USB, we will need to install the driver.


3.2 IR configuration function

3.2.1. New Controlled appliance


(1) Right-Click the **【IR learning code manager】** , select **【New Appliance】** in the shortcut menu, then set the appliance name in the following dialog box, click on **【OK】** .

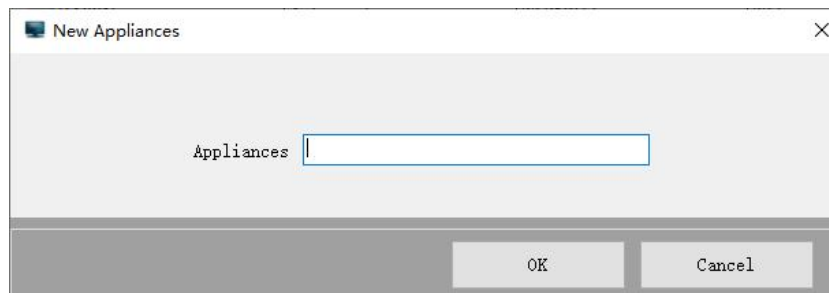


(2) Right-Click a appliance in IR learning code manager, select **【New function】** in the shortcut menu, pop-up dialog box shown below.

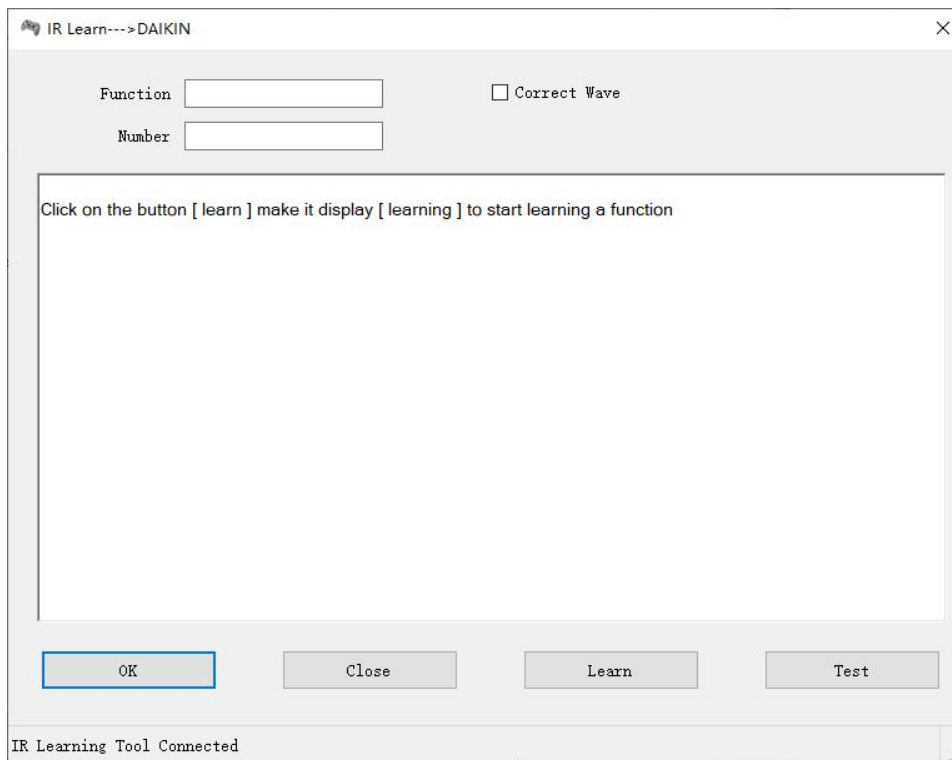

(3) Click on the button **【learn】** make it display **【learning】** , identify the software entering to the learning state. Then place the Emitter head of remote controller on receives head of learner about 0.5cm~2cm show as following.

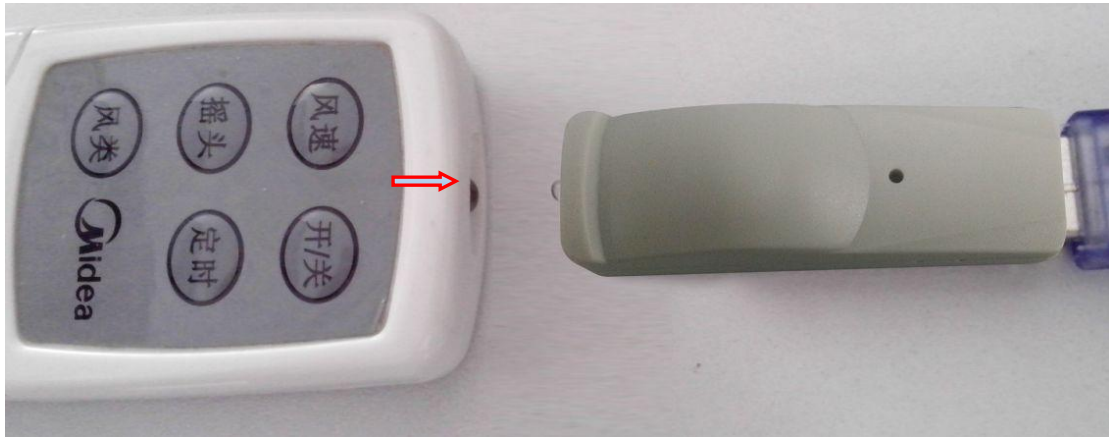


(4) Press the button on the remote control, When the IR learner receives the signal emitted by the remote control a button display the **【learning】** turn to **【learn】** to identify this study is completed, show as following .Then test the validity of this study.

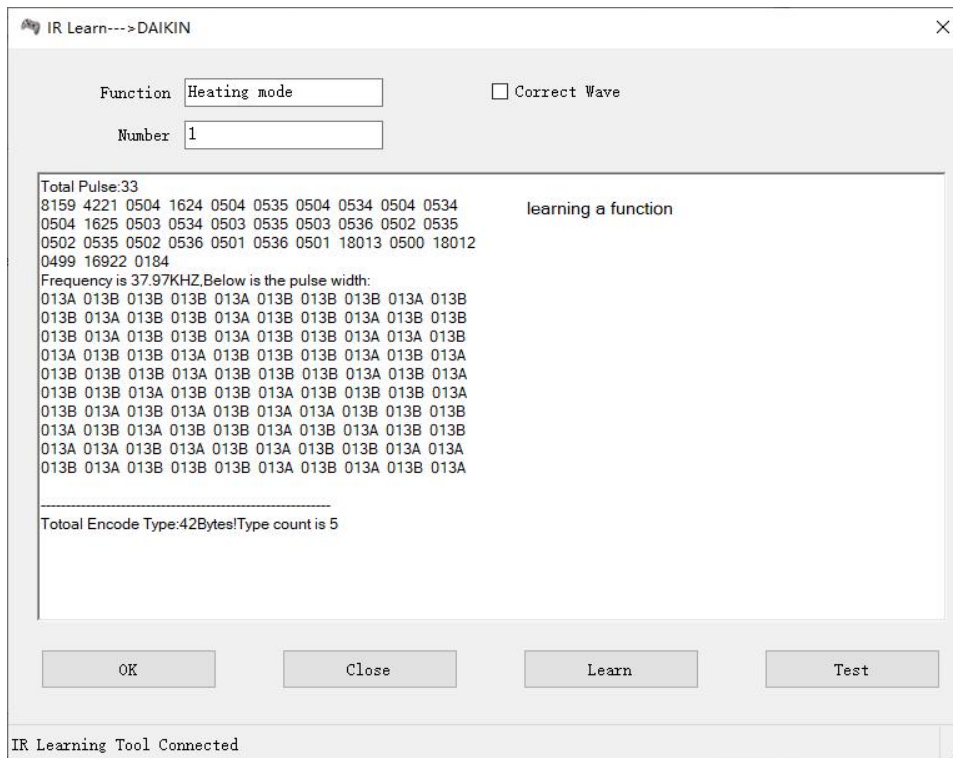

(5) Placed IR learner on the opposite of controlled electrical infrared receiver less than 4 meters, then click on the button **【Test】** to test this learning code, show as following. If the test is valid, click button **【OK】** to save this encoding, if invalid, repeat steps (2)~(4).

Note: Enter the function description and IR number before saving.

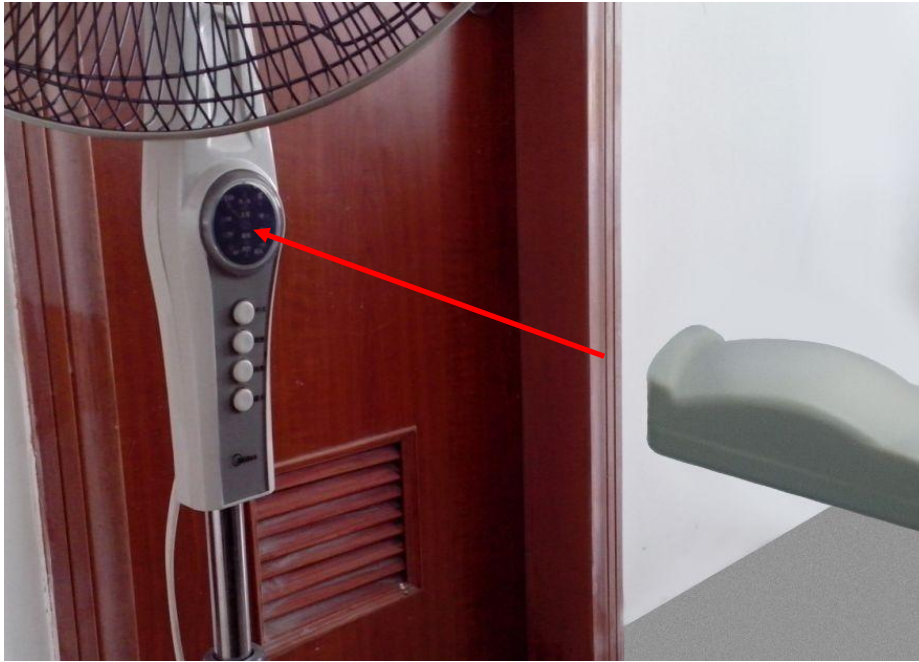

(6) Repeat steps (2)~(5) to complete the learning of remote controller function.


(7) Download the IR code to KNX Gateway for IR via KNX bus. Make sure that the bus is already connected and input the physical address of the device in the software interface, then click **【Download IR code】** to download.

3.2.2. Import\Export IR learning encoding data

After create electrical appliances, in order to backup data, we can export or import encoding data from IR learning Code manager, the file format only supports .IRCode3.


(1) Export IR learning coed file

Right-Click a appliance, select **【Export】** in the shortcut menu, then export the encoding of appliance. Show as the following figure. Set the corresponding information, then click **【OK】** .

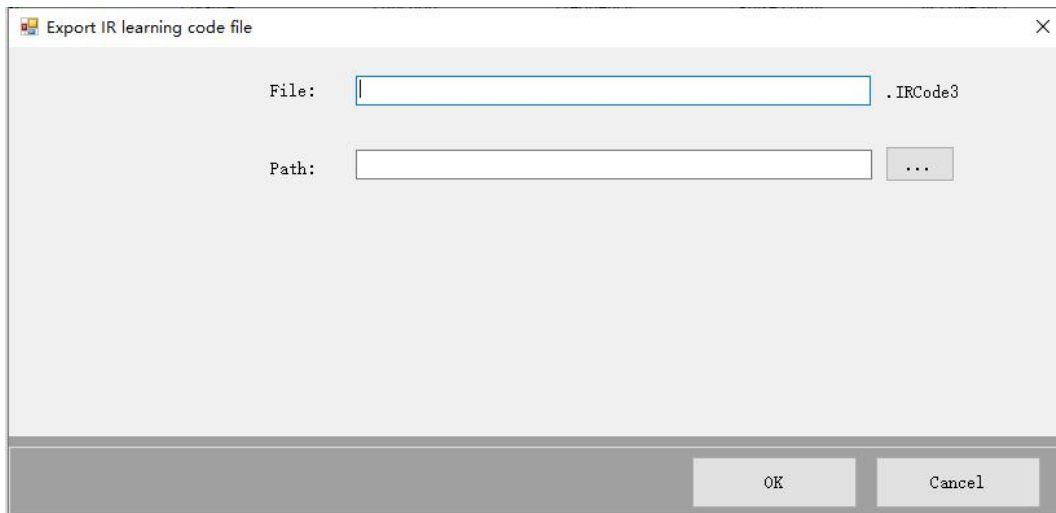

(2) Import IR learning coed file

Right-Click the IR Learning Code Manager, select **【Import】** in the shortcut menu, to import the IR code file. In the dialog, click button **【...】** to select the file, then click **【OK】** .

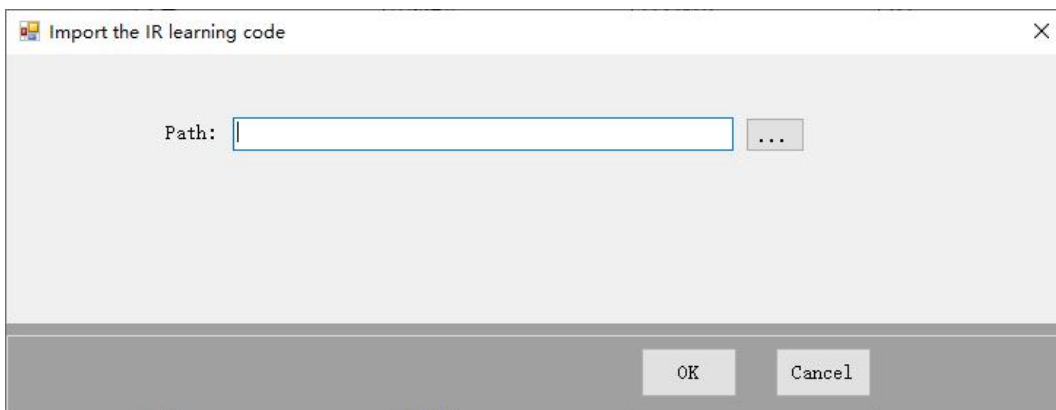

Note: After importing the IR code number, you need to confirm whether the IR code number is not 0.

If it is invalid or does not match the database settings, you need to manually modify it.

3.3 Precautions

- ① The stored path of configuration file should not be too long, the total path characters cannot exceed 255 characters;
- ② The configuration file name cannot exceed 255 characters;
- ③ Object (such as device, function) name cannot exceed 255 characters;
- ④ The file cannot be deleted when opened, otherwise the software will pop-up anomaly with cannot find the file;
- ⑤ “.IRPrj”files can only be opened with the software,otherwise it will damage the file.